
**TYPE 603****6-Volt Emergency Battery Pack Unit with Two Floodlights**

Unit shall conform to UL 924, NFPA 101, and shall meet or exceed the NFPA 70 time and voltage requirements. The unit shall be dual-rated for use on either 120-Volt or 277-Volt alternating current power supplies. Following sustained loss of the normal power supply, the unit shall be capable of automatically and instantaneously illuminating the two 6-Volt lighting fixtures for a period of not less than 90 minutes at a battery voltage in excess of 87.5 percent of the nominal voltage rating. The battery shall be the nickel-cadmium, pocket plate type designed to be maintenance free during the expected battery life, and shall be warranted for not less than 3 years from the date of the purchase of the unit, and shall be field replaceable without requiring removal of other components. The battery charger shall be the solid-state type and shall provide a continuous, variable, current limited, filtered and regulated charge rate. The battery and charger shall be contained in a steel cabinet not less than 18 gauge thickness with an enamel finish, unless otherwise approved, which shall be equipped with a push-to-test switch and a meter to indicate battery voltage when the switch is closed. Mounting brackets or shelf shall be provided, complete with all mounting hardware, all with a finish to match the finish or color of the cabinet. The unit shall be prewired and equipped with two 6-volt, 5-8 watt floodlights as indicated.

Fixture type indicated on this sheet shall also conform to requirements specified and indicated in the contract documents.

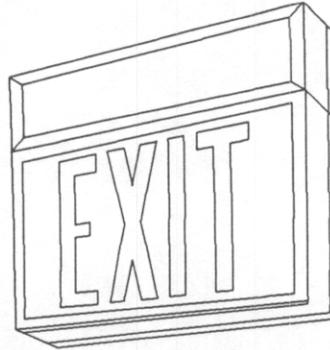

TYPE 604

Exit Sign With Self-Contained Emergency Battery

First Suffix	Second Suffix	Description
A		Single face
B		Double face
	1	End mounted
	2	Top mounted
	3	Back mounted
	4	Stem mounted

Unit shall conform to UL 924, NFPA 101, and shall meet or exceed the NFPA 70 time and voltage requirements. The unit shall be dual-rated for use on either 120-Volt or 277-Volt alternating current power supplies. Following sustained loss of the normal power supply, the unit shall be capable of automatically and instantaneously illuminating the two 6-Volt lighting fixtures for a period of not less than 90 minutes at a battery voltage in excess of 87.5 percent of the nominal voltage rating. The battery shall be the nickel-cadmium, pocket plate type designed to be maintenance free during the expected battery life, and shall be warranted for not less than 3 years from the date of the purchase of the unit, and shall be field replaceable without requiring removal of other components. The battery charger shall be the solid-state type and shall provide a continuous, variable, current limited, filtered and regulated charge rate. The battery and charger shall be contained in a steel cabinet not less than 18 gauge thickness with an enamel finish, unless otherwise approved, which shall be equipped with a push-to-test switch and a meter to indicate battery voltage when the switch is closed. Mounting brackets or shelf shall be provided, complete with all mounting hardware, all with a finish to match the finish or color of the cabinet. All ferrous metal parts shall receive a rust inhibitive coating before application of the finish coat. The fixture shall have a light-emitting diode pilot light to show that the battery charger is functioning. Fixture shall be prewired, with wiring concealed in the illuminated portion of the fixture housing.

Fixture type indicated on this sheet shall also conform to requirements specified and indicated in the contract documents.